



Enter settlement

Kiev region

Lviv region

Lviv

Odessa region

Sales anomalies


Network imbalance 835

Limit exceeded 15

Illegal water supply 27


Report for the current day

593 m3

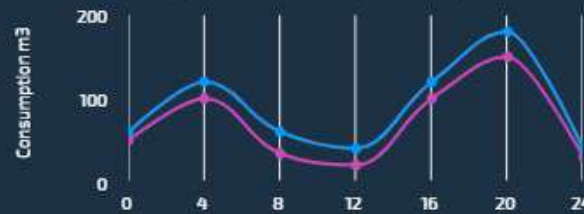

Equipment condition

A type	Name	condition
	Leak at the facility	12
	Flooding at the facility	5
	Exposure to electromagnetic fields	4
	No link to host	2
	Low battery	7
	Repairs	2
	Return flow	3
	Extreme pressure	18

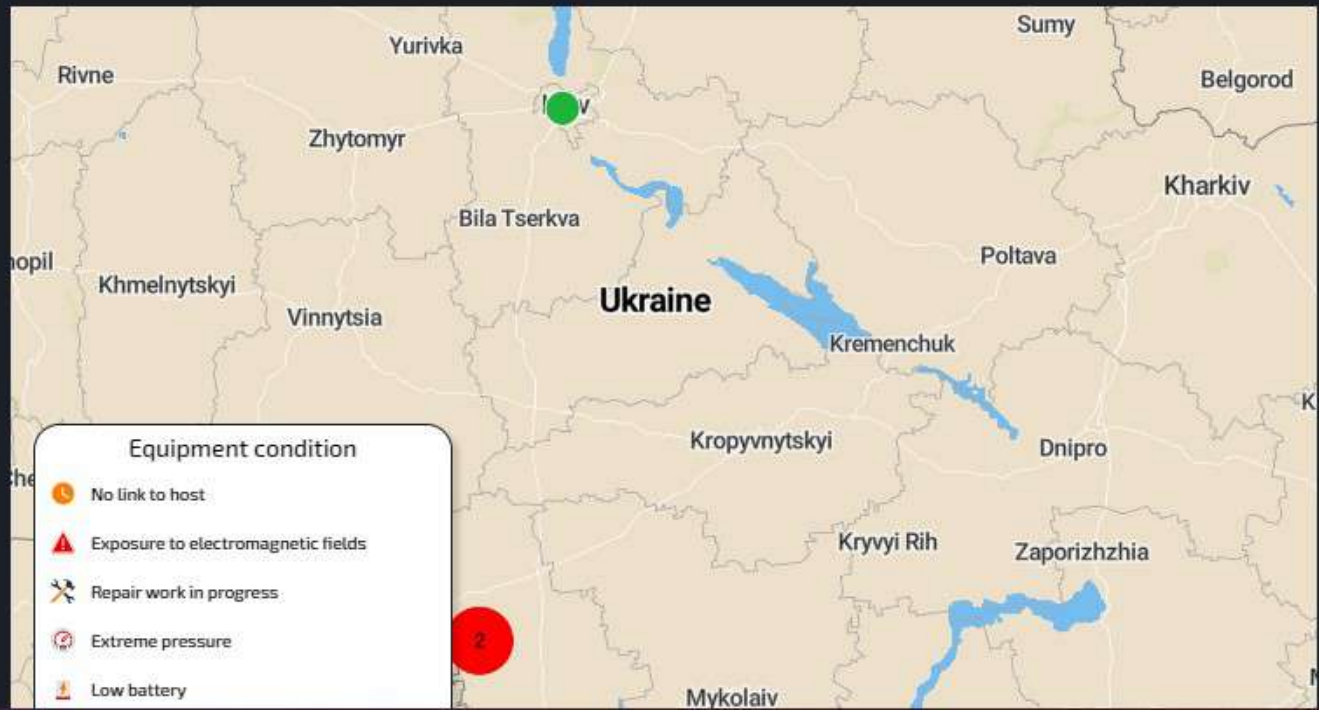



Meters data

Volume of water consumed

Minimum consumption

Maximum consumption

Lviv region

Lviv

ul. Bullet

40, k9

No. 134217750
0% battery charge 100%

40, k2

No. 50331812
0% battery charge 100%

40, k4

No. 134217749
0% battery charge 100%

40, k6

No. 50331811
0% battery charge 100%

40, k7


No. 50331806
0% battery charge 100%

Maximum heat map


Export

The date: March 2020

Clock

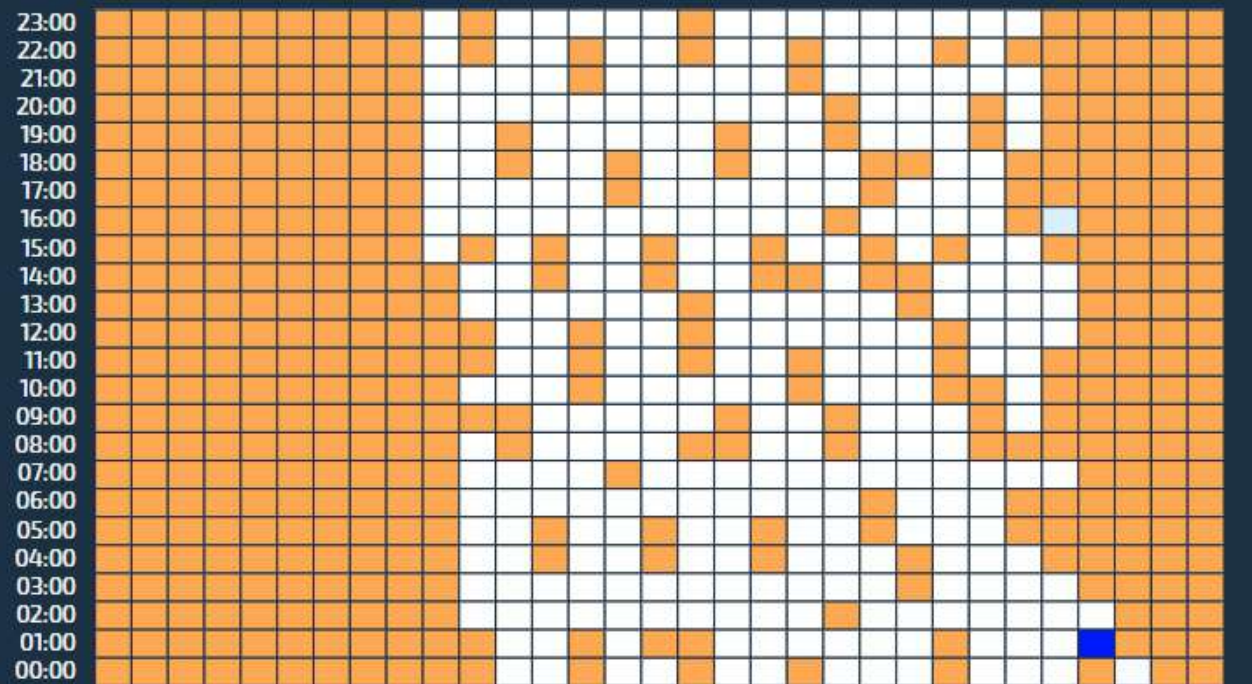

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31



There is no data



Water allocation

Consumption analysis

Comparative analysis

Peak Values

Consumption forecast

Plan / factual analysis

ABC analysis

Consumer share

Lviv region

Lviv

ul. Bullet

40, k9

No. 134217750
0% battery charge 100%

40, k2

No. 50331812
0% battery charge 100%


40, k4

No. 134217749
0% battery charge 100%

40, k6

Plan / Actual Analysis of Water Consumption

Until the end of the month

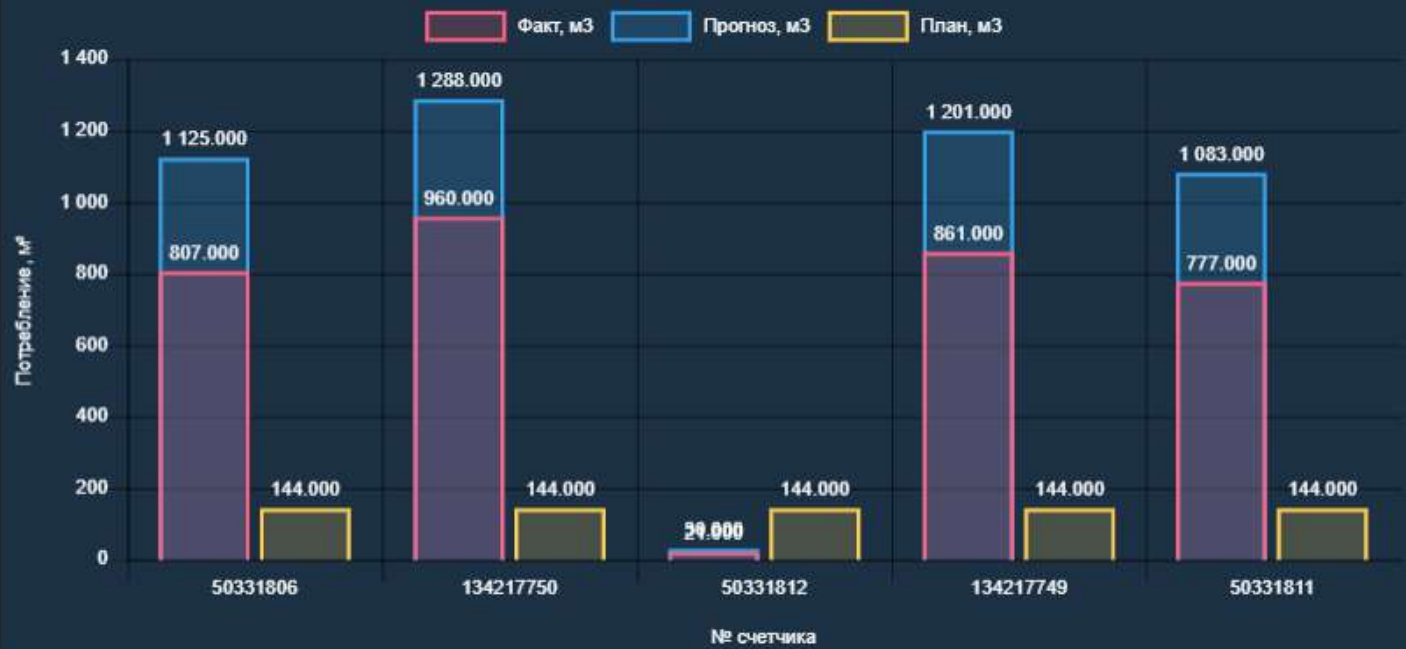



Water allocation

Consumption analysis

Comparative analysis

Peak Values

Consumption forecast

Plan / factual analysis

ABC analysis

Consumer share

Lviv region

Lviv

ul. Bullet

40, k9

No. 134217750
0% battery charge 100%

40, k2

No. 50331812
0% battery charge 100%

40, k4

No. 134217749
0% battery charge 100%

40, k6

Consumer share

Today

